This drawing is the property of VAT.

Revision

Customer number

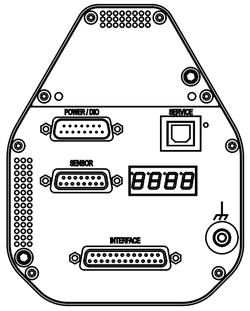


RS232 / RS485 / Logic

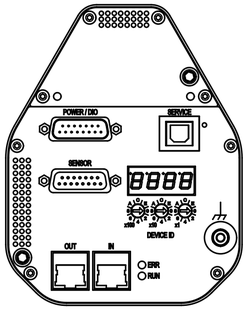


Ether CAT

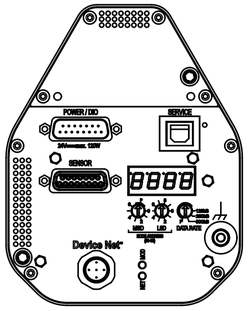


Device Net

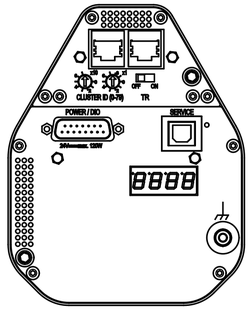


Valve Cluster Slave
(without interface)

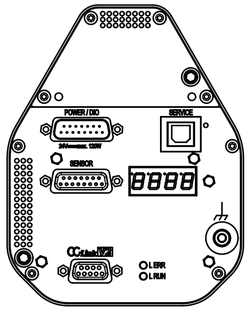


CC-Link

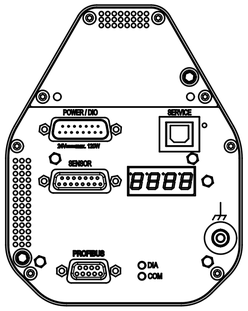


Profibus

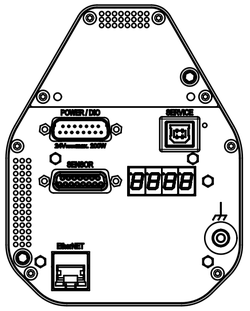


Ether Net

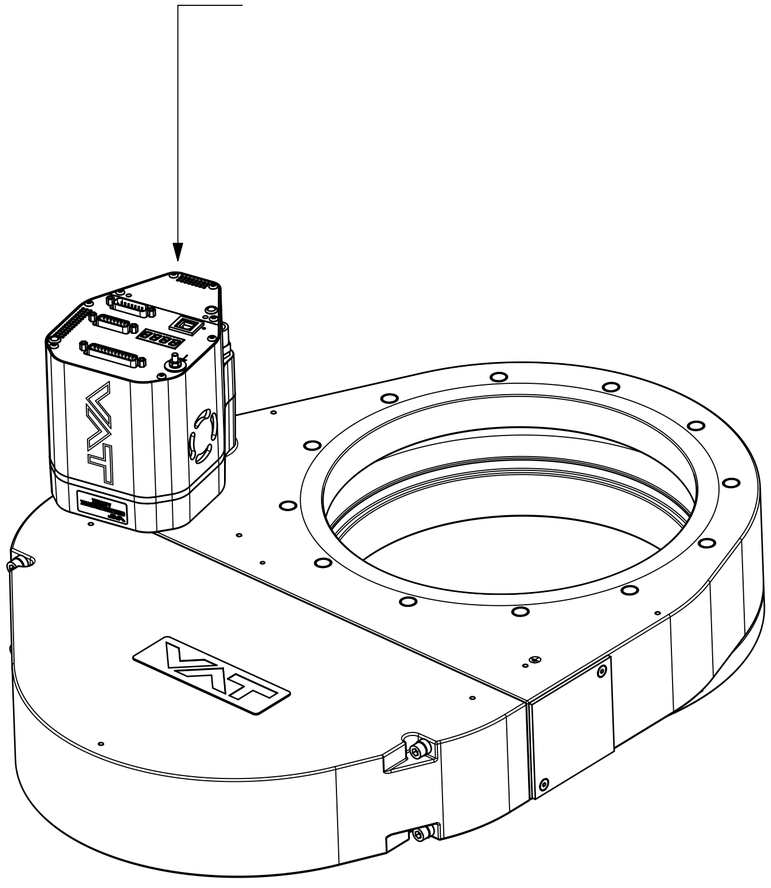


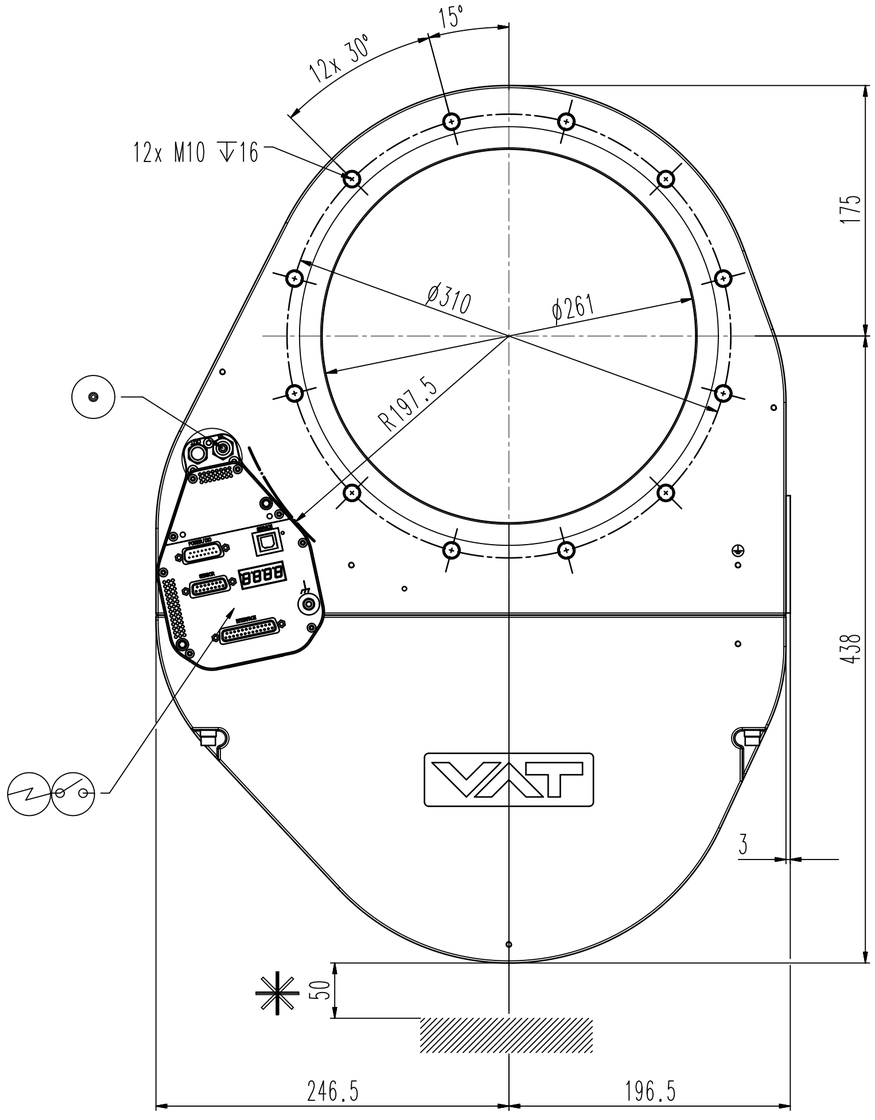


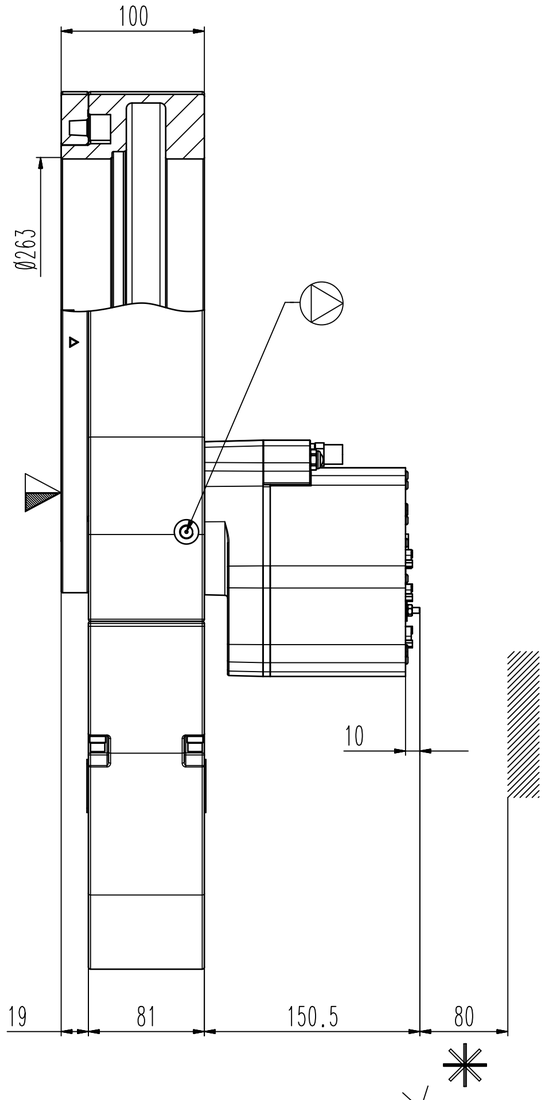


| | | | |
|---|---|---|---|
| ▼ Seat side<br>⊙ Comp. air connection<br>⊕ Electrical connection<br>◎ Leak detection port<br>◔ Mech. pos. indication<br>⊛ Position indicator<br>✱ Required for dismantling<br>◐ Emergency actuation<br>◘ For attachment<br>◍ Bake-out area<br>⊕ Differential pumping port | Control pendulum valve | Series<br>653 | Ordering No.<br>ISO Std |
| | | Projection E | DN / Flange<br>250 |
| VAT Vakuumventile AG<br>CH-9469 Haag , Switzerland<br>Tel ++41 81 7716161 Fax ++41 81 7714830 | Rev. Date: 27.06.24<br>Visa: TANK | Dimensional Drawing | 1297566 / Rev. A |

FOR INFORMATION ONLY
VAT MDA